

# ***Inspection Schedule- Swimming pools and hot tubs***

Name \_\_\_\_\_

Location \_\_\_\_\_

Date \_\_\_\_\_ Permit # \_\_\_\_\_

- A reasonable means of ingress must be provided to each structure.
- All required inspections must be called in 24 hours in advance by the owner or the contractor.



- All pool permits will ***expire*** one year from the date of issuance and are ***non-renewable***.
- The following inspections are ***mandatory for in-ground pools, above ground pools and hot tubs.***

1. When the excavation is complete, all panelized systems installed and or forms in place and ready for pouring concrete ***but before*** any concrete is poured ***or before*** any further construction.
2. An approved electrical inspection agency ***must observe*** all bonding and rough electrical work prior to covering.
3. Final - all construction must be completed as per the approved plans and specifications, favorable reports received from the approved electrical inspection agency and all requirements per Appendix "G" for the pool enclosures have been met.



Certificate of Compliance must be issued before any structure or part thereof is occupied.



I (please print) \_\_\_\_\_ agree upon applying for a permit to the terms herein and that I will call 24hrs in advance for each inspection required noted at: **585-786-8820**. I understand that failure to call for the required inspections could result in a "Stop Work Order" being issued, a \$100.00 fee imposed for each missed inspection along with assuming any additional expenses to show code compliance. A \$50.00 fee will be imposed for scheduling an inspection and access to perform such inspection cannot be made.



Signature \_\_\_\_\_ Date \_\_\_\_\_

Building Dept. Use Only  
Approved \_\_\_\_\_  
Denied \_\_\_\_\_  
CEO Initials \_\_\_\_\_

**Building Permit Application**  
**Wyoming County Building Department**  
Agricultural & Business Center  
36 Center St., Suite C  
Warsaw, NY 14569  
ph(585) 786-8820  
fax(585) 786-6020  
e-mail – [droberts@wyomingco.net](mailto:droberts@wyomingco.net)

Estimated Cost \_\_\_\_\_  
Fee to be paid upon filling  
this application \_\_\_\_\_

Date: \_\_\_\_\_

Tax Parcel# \_\_\_\_\_

**Instructions:**

1. This application must be completely filled in by typewriter or ink and submitted in duplicate to the Building Department.
2. A plot plan showing location of lot and of buildings on premises, relationship to adjoining premises or public streets or areas, and giving a detailed description of layout of property must be submitted with this application.
3. This application must be accompanied by two sets of construction drawings showing proposed construction along with two sets of specifications. Plans and specifications shall describe the nature of work to be performed, the materials and equipment to be used and installed and details of structural, mechanical, electrical, heating and plumbing installations.
4. The work covered in this application shall not commence prior to issuance of Building Permit.
5. Upon approval, the Building Department shall issue a building permit to the applicant, with approved duplicate set of plans and specifications. Such permit and specifications shall be kept on premises available for inspection throughout the work progress.
6. No building shall be occupied or used in whole or in part for any purpose, until a certificate of occupancy has been issued for such use by the Building Department.
7. Upon permit issuance, all work is to be completed within 12 months or a permit renewal must be obtained.

**Application is hereby made to the Building Department** for the issuance of a Building Permit pursuant to The New York State Uniform Fire Prevention and Building Code for the construction of buildings, additions, alterations, or for removal or demolition, as herein described. The applicant agrees to comply with all applicable laws, ordinances and regulations.

Project Location: \_\_\_\_\_ Municipality: \_\_\_\_\_  
 Owners Name: \_\_\_\_\_ Phone# \_\_\_\_\_  
 Owners Address: \_\_\_\_\_  
 State whether applicant is owner, lessee, agent architect, engineer or builder: \_\_\_\_\_  
 Applicants Name: \_\_\_\_\_ Phone# \_\_\_\_\_  
 Applicants Address: \_\_\_\_\_

1. Project Description: \_\_\_\_\_
2. Is the project located within a floodplain: Yes \_\_\_\_\_ No \_\_\_\_\_
3. Is this a change of use and or occupancy (check): Yes \_\_\_\_\_ No \_\_\_\_\_
4. Nature of work (check): New Structure \_\_\_ Addition \_\_\_ Alteration \_\_\_ Repair \_\_\_ Removal \_\_\_ Demo \_\_\_  
Pool \_\_\_ Solid Fuel \_\_\_ Other (give description) \_\_\_\_\_
5. Dimensions of new structure: Front \_\_\_\_\_ Rear \_\_\_\_\_ Depth \_\_\_\_\_ Height \_\_\_\_\_ Number of Stories \_\_\_\_\_
6. Dimensions of Addition: Front \_\_\_\_\_ Rear \_\_\_\_\_ Depth \_\_\_\_\_ Height \_\_\_\_\_ Number of Stories \_\_\_\_\_
7. If Alterations, state nature of work: \_\_\_\_\_
8. Name of Contractor: \_\_\_\_\_ Phone# \_\_\_\_\_
9. Name of Design Professional: \_\_\_\_\_ Phone# \_\_\_\_\_

**Applicants Signature:** \_\_\_\_\_ (S) He is the owner, agent or contractor of said owner or owners, and is duly authorized to perform or have performed the said work and to make and file this application; that all statements contained herein are true to the best of his or her knowledge and belief, and that the work will be performed in the manor set forth in the application and in the plans and specification filled herewith. Permission is granted to the Wyoming County Building Department to enter upon premises to conduct all necessary inspections.

**Intake Sheet Items Needed For All Building Permits**

Last Name/Permit# \_\_\_\_\_ → Job Information

\_\_\_\_ One & Two Family Home  
\_\_\_\_ Manufactured Home – Year & Model \_\_\_\_\_  
\_\_\_\_ Additions, Alterations, Renovations  
\_\_\_\_ Deck, Storage Bldg, Pole Barn, Shed  
\_\_\_\_ Re-roof  
\_\_\_\_ Swimming Pool – Size & Model \_\_\_\_\_  
\_\_\_\_ Commercial

→ Project Type

\_\_\_\_ Application  
\_\_\_\_ Fee Paid, Check payable to: Wyoming County Treasurer or cash  
\_\_\_\_ Zoning permit issued by the Municipality per project location  
\_\_\_\_ Septic permit issued by the Wyoming County Health Dept.(if private)  
\_\_\_\_ Well permit issued by the Wyoming County Health Dept.(if private)  
\_\_\_\_ Property address/Drive-way permit issued by the Wyoming Co. Highway Dept.  
\_\_\_\_ Inspection Schedule Signed  
\_\_\_\_ Plans–2 Sets, (If over 1500 sq', NYS architect or engineer must seal the drawings)  
\_\_\_\_ Pre-cast foundations (NYS sealed foundation plans and an approved soil test)  
\_\_\_\_ Heat Type/Fuel Type \_\_\_\_\_  
\_\_\_\_ Energy Certificate completed

→ Check List Items

\_\_\_\_ Final septic approval issued by the Wyoming County Health Department  
\_\_\_\_ Final well completion and favorable water test completed by the Wyoming County Health Department  
\_\_\_\_ Final electrical certificate issued by the approved 3rd party inspection agency.  
\_\_\_\_ 3<sup>rd</sup> party testing as required by 2015 IECC Chapter 4  
\_\_\_\_ NYS sealed truss certificate drawings providing all required loads noted on the drawings in compliance with NYS Code requirements.  
\_\_\_\_ All required construction inspections completed by the Wyoming County Building Department or an approved agency for the purpose of performing any “special inspections” as required by the Building Official.  
\_\_\_\_ Soil test report reflecting soil classification and soil bearing capacity.

→ Reports due prior to certificates issued

\_\_\_\_ Contractors Name and proper Insurance Certificates  
\_\_\_\_ BP-1 signed (required if no contractor involved)

→ Insurance Requirements

 I have read the above requirements and understand that all specific reports required by the work I'm performing, must be submitted prior to obtaining any Certificates from the Wyoming County Building Department and that NO OCCUPANCY may take place in any part thereof until such Certificates are obtained.

 **Signature** \_\_\_\_\_ **Date** \_\_\_\_\_

**ELECTRICAL INSPECTORS (REV 5/9/17)**

**COMMONWEALTH ELECTRICAL INSPECTION SERVICE, INC 1-800-801-0309**

Frank Boncore – (716) 207-0422 (before 5 pm)    Robert Bourgoine – (585) 335-8461 or (585) 314-8461  
Patrick Cullinan, - (716) 316-7091                      Bob Smith – (716) 492-2756 (between 7 am – 8 am)

**EMPIRE INSPECTIONS, LLC**

Tim Enderby – (585) 798-1849    Mike Rearic (585) 318-4316

**MIDDLE DEPARTMENT INSPECTION AGENCY, INC.**

Bill Davis – (585) 409-5024

**NIAGARA FRONTIER INSPECTION AGENCY**

John Garven – (716) 276-1200

**NY ELECTRICAL INSPECTION AGENCY (585) 436-4460**

Fritz Gunther – (585) 230-4186                      Greg Harmer – (585) 730-0407  
John Neu – (585) 737-7893



**2017 UNIFORM CODE SUPPLEMENT**

Published by the New York State Department of State

**Publication Date: July 2017**

© 2017 New York State Department of State

2.23.	2015 IRC Section R324 (Solar energy systems) .....	33
2.24.	2015 IRC Section R326 (Swimming pools, spas and hot tubs) .....	35
2.25.	2015 IRC Sections R404.2.1 (Identification), R502.1.1 (Sawn lumber), R602.1.1 (Sawn lumber) and R802.1.1 (Sawn lumber).....	42
2.26.	2015 IRC Section N1101.1 (Scope) .....	42
2.27.	2015 IRC Section N1101.3 ((R101.5.1) Compliance materials). .....	43
2.28.	2015 IRC Section N1101.6 ((R202) Defined terms). .....	43
2.29.	2015 IRC Section N1102.1 ((R402.1) General (Prescriptive)).....	44
2.30.	2015 IRC Section N1102.1.2 ((402.1.2) Insulation and fenestration criteria). .....	45
2.31.	2015 IRC Table N1102.1.2 ((R402.1.2) Insulation and Fenestration Requirements by Component <sup>a</sup> ). .....	45
2.32.	2015 IRC Section N1102.4 ((R402.4) Air leakage (Mandatory)). .....	46
2.33.	2015 IRC Section N1102.4.1.2 ((R402.4.1.2) Testing). .....	46
2.34.	2015 IRC Section N1102.4.1 ((R402.4.1) Building thermal envelope).....	46
2.35.	2015 IRC Section N1102.4.2 ((R402.4.2) Fireplaces). .....	48
2.36.	2015 IRC Section N1102.4 ((R402.4) Air leakage (Mandatory)). .....	48
2.37.	2015 IRC Section N1103.10.3 ((R403.10.3) Covers).....	49
2.38.	2015 IRC Section N1103.12 ((R403.12) Residential pools and permanent residential spas). ....	49
2.39.	2015 IRC Section N1107.4 (Compliance).....	49
2.40.	2015 IRC Section N1107.6 ((R501.6) Historic buildings). .....	50
2.41.	2015 IRC Section M1401 (General).....	50
2.42.	2015 IRC Chapter 14 (Heating and cooling equipment and appliances).....	50
2.43.	2015 IRC Section G2411.1.1 (310) (CSST).....	51
2.44.	2015 IRC Section G2411 (310) (Electrical bonding) .....	51
2.45.	2015 IRC Section G2415.7 (404.7) (Protection against physical damage) .....	52
2.46.	2015 IRC Section G2431 (General) .....	53
2.47.	2015 IRC Section P2602 (Individual water supply and sewage disposal).....	54
2.48.	2015 IRC Section P2902.1 (General).....	54
2.49.	2015 IRC Section P2902.3 (Backflow prevention) .....	54
2.50.	2015 IRC Table P2903.2 (Maximum flow rates and consumption for plumbing fixtures and fixture fittings) .....	55
2.51.	2015 IRC Section E3401.2 (Scope).....	55
2.52.	2015 IRC Section E3609.7 (Bonding other metal piping).....	55
2.53.	2015 IRC Appendix E (Manufactured housing used as dwellings).....	56
2.54.	2015 IRC Appendix J (Existing buildings and structures) .....	63

### CHAPTER 3

Amendments to the 2015 IBC.....	95
3.1. 2015 IBC Chapter 1 (Scope and Administration).....	95
3.2. 2015 IBC Section 202 (Definitions).....	95
3.3. 2015 IBC Chapter 4 (Special detailed requirements based on use and occupancy). .....	96
3.4. 2015 IBC Table 602 (Fire-resistance rating requirements for exterior walls based on fire separation distance).....	98
3.5. 2015 IBC Table 705.8 (Maximum Area of Exterior Wall Openings Based on Fire Separation	

2. Where vertical ventilation techniques will not be employed.
3. Detached garages and accessory structures.

**R324.7.1 Size of solar photovoltaic array.** Each photovoltaic array shall not exceed 150 feet (45 720 mm) in any direction.

**R324.7.2 Roof access points.** Roof access points shall be located:

1. In areas that establish access pathways that are independent of each other and as remote from each other as practicable so as to provide escape routes from all points along the roof;
2. In areas that do not require the placement of ground ladders over openings such as windows or doors or areas that may cause congestion or create other hazards;
3. At strong points of building construction, such as corners, pilasters, hips, and valleys, and other areas capable of supporting the live load from emergency responders;
4. Where the roof access point does not conflict with overhead obstructions such as tree limbs, wires or signs;
5. Where the accompanying ground access area does not conflict with ground obstructions such as decks, fences, or landscaping; and
6. In areas that minimize roof tripping hazards such as vents, skylights, satellite dishes, antennas, or conduit runs.

**R324.7.3 Ground access areas.** Ground access areas shall be located beneath access roofs and roof access points so as to facilitate roof access. The minimum width of the ground access area shall be the full width of the access roof or roof access point, measured at the eave. The minimum depth shall allow for the safe placement of ground ladders for gaining entry to the access roof.

**R324.7.4 Single ridge roofs.** Panels, modules, or arrays installed on roofs with a single ridge shall be located in a manner that provides two, 36 inches wide (914 mm) access pathways extending from the roof access point to the ridge. Access pathways on opposing roof slopes shall not be located along the same plane as the truss, rafter, or other such framing system that supports the pathway.

**Exceptions:**

1. Roofs with slopes of 2 units vertical in 12 units horizontal (16.6 percent) and less.
2. Structures where an access roof fronts a street, driveway, or other area readily accessible to emergency responders.
3. One access pathway shall be required when the ridge or ventable area of a roof slope containing panels, modules or arrays is located not more than 24 inches (610 mm) vertically from an adjoining roof which contains an access roof.

**R324.7.5 Hip roofs.** Panels, modules, and arrays installed on dwellings with hip roofs shall be located in a manner that provides a clear access pathway not less than 36 inches

wide (914 mm), extending from the roof access point to the ridge or peak, on each roof slope where panels, modules, or arrays are located.

**Exceptions:**

1. Roofs with slopes of 2 units vertical in 12 units horizontal (16.6 percent) and less.
2. Structures where an access roof fronts a street, driveway, or other area readily accessible to emergency responders.

**R324.7.6 Roofs with valleys.** Panels and modules shall not be located less than 18 inches (457 mm) from a valley.

**Exception:** Roofs with slopes of 2 units vertical in 12 units horizontal (16.6 percent) and less.

**R324.7.7 Allowance for smoke ventilation operations.** Panels and modules shall not be located less than 18 inches (457 mm) from a ridge or peak.

**Exceptions:**

1. Where an alternative ventilation method has been provided.
2. Where vertical ventilation methods will not be employed between the upper most portion of the solar photovoltaic system and the roof ridge or peak.
3. Detached garages and accessory structures.

**2.24. 2015 IRC Section R326 (Swimming pools, spas and hot tubs).**

Section R326 of the 2015 IRC shall be deemed to be amended in its entirety to read as follows:

**SECTION R326  
SWIMMING POOLS, SPAS AND HOT TUBS**

**SECTION R326.1  
GENERAL**

**R326.1 General.** The provisions of this Section shall control the design and construction of swimming pools, spas and hot tubs installed in or on the lot of a one- or two-family dwelling.

**SECTION R326.2  
DEFINITIONS**

**R326.2 Definitions.** For the purposes of these requirements, the terms used shall be defined as follows and as set forth in Chapter 2.

**ABOVE-GROUND/ON-GROUND POOL.** See "Swimming pool".

**BARRIER, PERMANENT.** A fence, wall, building wall or combination thereof which completely surrounds the swimming pool and obstructs access to the swimming pool.

**BARRIER, TEMPORARY.** An approved temporary fence, permanent fence, the wall of a permanent structure, any other structure, or any combination thereof that prevents access to the swimming pool by any person not engaged in the installation or construction of the swimming pool during its installation or construction.

**HOT TUB.** See "Swimming pool".

**IN-GROUND POOL.** See "Swimming pool".

**RESIDENTIAL.** That which is situated on the premises of a detached one- or two-family dwelling or a one-family townhouse not more than three stories in height.

**SPA, NONPORTABLE.** See "Swimming pool".

**SPA, PORTABLE.** A nonpermanent structure intended for recreational bathing, in which all controls, water-heating and water-circulating equipment are an integral part of the product.

**SUBSTANTIAL DAMAGE.** For the purpose of determining compliance with the pool alarm provisions of this appendix, damage of any origin sustained by a swimming pool whereby the cost of restoring the swimming pool to its before-damaged condition would equal or exceed 50 percent of the market value of the swimming pool before the damage occurred.

**SUBSTANTIAL MODIFICATION.** For the purpose of determining compliance with the pool alarm provisions of this appendix, any repair, alteration, addition or improvement of a swimming pool, the cost of which equals or exceeds 50 percent of the market value of the swimming pool before the improvement or repair is started. If a swimming pool has sustained substantial damage, any repairs are considered substantial modification regardless of the actual repair work performed.

**SWIMMING POOL.** Any structure, basin, chamber or tank which is intended for swimming, diving, recreational bathing or wading and which contains, is designed to contain, or is capable of containing water more than 24 inches (610 mm) deep at any point. This includes in-ground, above-ground and on-ground pools; indoor pools; hot tubs; spas; and, fixed-in-place wading pools.

**SWIMMING POOL, INDOOR.** A swimming pool which is totally contained within a structure and surrounded on all four sides by the walls of the enclosing structure.

**SWIMMING POOL, OUTDOOR.** Any swimming pool which is not an indoor pool.

### SECTION R326.3 SWIMMING POOLS

**R326.3.1 In-ground pools.** In-ground pools shall be designed and constructed in conformance with ANSI/NSPI-5.

**R326.3.2 Above-ground and on-ground pools.** Above-ground and on-ground pools shall be designed and constructed in conformance with ANSI/NSPI-4.

### SECTION R326.4 SPAS AND HOT TUBS

**R326.4.1 Permanently installed spas and hot tubs.** Permanently installed spas and hot tubs shall be designed and constructed in conformance with ANSI/NSPI-3 (Standard for Permanently Installed Residential Spas, 1999).

**R326.4.2 Portable spas and hot tubs.** Portable spas and hot tubs shall be designed and constructed in conformance with ANSI/NSPI-6.

### SECTION R326.5 BARRIER REQUIREMENTS

**R326.5.1 Application.** The provisions of this section shall control the design of barriers for residential swimming pools, spas and hot tubs. These design controls are intended to provide protection against potential drowning and near-drowning by restricting access to swimming pools, spas and hot tubs.

**R326.5.2 Temporary barriers.** An outdoor swimming pool, including an in-ground, above-ground or on-ground pool, hot tub or spa shall be surrounded by a temporary barrier during installation or construction and shall remain in place until a permanent barrier in compliance with Section R326.5.3 is provided.

**Exceptions:**

1. Above-ground or on-ground pools where the pool structure is the barrier in compliance with Section R326.5.3.
2. Spas or hot tubs with a safety cover which complies with ASTM F 1346, provided that such safety cover is in place during the period of installation or construction of such hot tub or spa. The temporary removal of a safety cover as required to facilitate the installation or construction of a hot tub or spa during periods when at least one person engaged in the installation or construction is present is permitted.

**R326.5.2.1 Height.** The top of the temporary barrier shall be at least 48 inches (1219 mm) above grade measured on the side of the barrier which faces away from the swimming pool.

**R326.5.2.2 Replacement by a permanent barrier.** A temporary barrier shall be replaced by a complying permanent barrier within either of the following periods:

1. 90 days of the date of issuance of the building permit for the installation or construction of the swimming pool; or
2. 90 days of the date of commencement of the installation or construction of the swimming pool.

**R326.5.2.2.1 Replacement extension.** Subject to the approval of the code enforcement official, the time period for completion of the permanent barrier may be extended for good cause, including, but not limited to, adverse weather conditions delaying construction.

**R326.5.3 Permanent barriers.** An outdoor swimming pool, including an in-ground, above-ground or on-ground pool, hot tub or spa shall be surrounded by a barrier which shall comply with the following:

1. The top of the barrier shall be at least 48 inches (1219 mm) above grade measured on the side of the barrier which faces away from the swimming pool. The maximum vertical clearance between grade and the bottom of the barrier shall be 2 inches (51 mm) measured on the side of the barrier which faces away from the swimming pool. Where the top of the pool structure is above grade, such as an above-ground pool, the barrier may be at ground level, such as the pool structure, or mounted on top of the pool structure. Where the barrier is mounted on top of the pool structure, the maximum vertical clearance between the top of the pool structure and the bottom of the barrier shall be 4 inches (102 mm).
2. Openings in the barrier shall not allow passage of a 4-inch-diameter (102 mm) sphere.
3. Solid barriers which do not have openings, such as a masonry or stone wall, shall not contain indentations or protrusions except for normal construction tolerances and tooled masonry joints.
4. Where the barrier is composed of horizontal and vertical members and the distance between the tops of the horizontal members is less than 45 inches (1143 mm), the horizontal members shall be located on the swimming pool side of the fence. Spacing between vertical members shall not exceed 1<sup>3</sup>/<sub>4</sub> inches (44 mm) in width. Where there are decorative cutouts within vertical members, spacing within the cutouts shall not exceed 1<sup>3</sup>/<sub>4</sub> inches (44 mm) in width.
5. Where the barrier is composed of horizontal and vertical members and the distance between the tops of the horizontal members is 45 inches (1143 mm) or more, spacing between vertical members shall not exceed 4 inches (102 mm). Where there are decorative cutouts within vertical members, spacing within the cutouts shall not exceed 1<sup>3</sup>/<sub>4</sub> inches (44 mm) in width.
6. Maximum mesh size for chain link fences shall be a 2<sup>1</sup>/<sub>4</sub>-inch (57 mm) square unless the fence has slats fastened at the top or the bottom which reduce the openings to not more than 1<sup>3</sup>/<sub>4</sub> inches (44 mm).
7. Where the barrier is composed of diagonal members, such as a lattice fence, the maximum opening formed by the diagonal members shall not be more than 1<sup>3</sup>/<sub>4</sub> inches (44 mm).

8. Gates shall comply with the requirements of Section R326.5.3, Items 1 through 7, and with the following requirements:
  - 8.1. All gates shall be self-closing. In addition, if the gate is a pedestrian access gate, the gate shall open outward, away from the pool.
  - 8.2. All gates shall be self-latching, with the latch handle located within the enclosure (i.e., on the pool side of the enclosure) and at least 40 inches (1016 mm) above grade. In addition, if the latch handle is located less than 54 inches (1372 mm) from the bottom of the gate, the latch handle shall be located at least 3 inches (76 mm) below the top of the gate, and neither the gate nor the barrier shall have any opening greater than 0.5 inch (12.7 mm) within 18 inches (457 mm) of the latch handle.
  - 8.3. All gates shall be securely locked with a key, combination or other child proof lock sufficient to prevent access to the swimming pool through such gate when the swimming pool is not in use or supervised.
9. Where a wall of a dwelling serves as part of the barrier, one of the following conditions shall be met:
  - 9.1. The pool shall be equipped with a powered safety cover in compliance with ASTM F 1346; or
  - 9.2. Doors with direct access to the pool through that wall shall be equipped with an alarm which produces an audible warning when the door and/or its screen, if present, are opened. The alarm shall be listed in accordance with UL 2017. The audible alarm shall activate within 7 seconds and sound continuously for a minimum of 30 seconds after the door and/or its screen, if present, are opened and be capable of being heard throughout the house during normal household activities. The alarm shall automatically reset under all conditions. The alarm system shall be equipped with a manual means, such as touch pad or switch, to temporarily deactivate the alarm for a single opening. Deactivation shall last for not more than 15 seconds. The deactivation switch(es) shall be located at least 54 inches (1372 mm) above the threshold of the door; or
  - 9.3. Other means of protection, such as self-closing doors with self-latching devices, shall be acceptable so long as the degree of protection afforded is not less than the protection afforded by Item 9.1 or 9.2 described above.
10. Where an above-ground pool structure is used as a barrier or where the barrier is mounted on top of the pool structure, and the means of access is a ladder or steps:
  - 10.1. The ladder or steps shall be capable of being secured, locked or removed to prevent access; or
  - 10.2. The ladder or steps shall be surrounded by a barrier which meets the requirements of Section R326.5.3, Items 1 through 9. When the ladder or steps are secured, locked or removed, any opening created shall not allow the passage of a 4-inch-diameter (102 mm) sphere.

**R326.5.4 Indoor swimming pool.** Walls surrounding an indoor swimming pool shall comply with Section R326.5.3, Item 9.

**R326.5.5 Prohibited locations.** Barriers shall be located to prohibit permanent structures, equipment or similar objects from being used to climb them.

**R326.5.6 Barrier exceptions.** Spas or hot tubs with a safety cover which complies with ASTM F 1346 shall be exempt from the provisions of this appendix.

## **SECTION R326.6 ENTRAPMENT PROTECTION FOR SWIMMING POOL AND SPA SUCTION OUTLETS**

**R326.6.1 General.** Suction outlets shall be designed to produce circulation throughout the pool or spa. Single-outlet systems, such as automatic vacuum cleaner systems, or multiple suction outlets, whether isolated by valves or otherwise, shall be protected against user entrapment.

**R326.6.1.1 Compliance alternative.** Suction outlets may be designed and installed in accordance with ANSI/APSP-7.

**R326.6.2 Suction fittings.** Pool and spa suction outlets shall have a cover that conforms to ANSI/ASME A112.19.8M, or an 18 inch by 23 inch (457 mm by 584 mm) drain grate or larger, or an approved channel drain system.

**Exception:** Surface skimmers.

**R326.6.3 Atmospheric vacuum relief system required.** Pool and spa single- or multiple-outlet circulation systems shall be equipped with atmospheric vacuum relief should grate covers located therein become missing or broken. This vacuum relief system shall include at least one approved or engineered method of the type specified herein, as follows:

1. Safety vacuum release system conforming to ASME A112.19.17; or
2. An approved gravity drainage system.

**R326.6.4 Dual drain separation.** Single or multiple pump circulation systems have a minimum of two suction outlets of the approved type. A minimum horizontal or vertical distance of 3 feet (914 mm) shall separate the outlets. These suction outlets shall be piped so that water is drawn through them simultaneously through a vacuum-relief-protected line to the pump or pumps.

**R326.6.5 Pool cleaner fittings.** Where provided, vacuum or pressure cleaner fitting(s) shall be located in an accessible position(s) at least 6 inches (152 mm) and not more than 12 inches (305 mm) below the minimum operational water level or as an attachment to the skimmer(s).

## **SECTION R326.7 SWIMMING POOL AND SPA ALARMS**

**R326.7.1 Applicability.** A swimming pool or spa installed, constructed or substantially modified after December 14, 2006, shall be equipped with an approved pool alarm.

**Exceptions:**

1. A hot tub or spa equipped with a safety cover which complies with ASTM F1346.
2. A swimming pool (other than a hot tub or spa) equipped with an automatic power safety cover which complies with ASTM F1346.

Pool alarms shall comply with ASTM F2208 (Standard Specification for Pool Alarms), and shall be installed, used and maintained in accordance with the manufacturer's instructions and this section.

**R326.7.2 Multiple alarms.** A pool alarm must be capable of detecting entry into the water at any point on the surface of the swimming pool. If necessary to provide detection capability at every point on the surface of the swimming pool, more than one pool alarm shall be provided.

**R326.7.3 Alarm activation.** Pool alarms shall activate upon detecting entry into the water and shall sound poolside and inside the dwelling.


**R326.7.4 Prohibited alarms.** The use of personal immersion alarms shall not be construed as compliance with this section.

**SECTION R326.8  
STANDARDS**


**R326.8.1 General.** The following table lists the standards that are referenced in Section R326 that are neither listed in Chapter 44 of the 2015 IRC, nor Chapter 10 of this Supplement. The standards are listed by the promulgating agency of the standard, the standard identification, the effective date and title, and the section(s) of Section R326 that reference the standard. Referenced standards that have been incorporated by reference into 19 NYCRR Parts 1220 through 1228 are located in Chapter 10 of this Supplement. Application of referenced standards shall be as specified in Section 102.5.

<b>Standard number</b>	<b>Title</b>	<b>Where referenced</b>
<b>ASTM</b>	<b>ASTM International 100 Barr Harbor Dr, West Conshohocken, PA 19428</b>	
ASTM F2208-2008	Standard Specification for Pool Alarms	R326.7.1
<b>NSPI</b>	<b>National Spa and Pool Institute 2111 Eisenhower Avenue, Alexandria, VA 22314</b>	
ANSI/NSPI-3-99	Standard for Permanently Installed Residential Spas	R326.4.1
ANSI/NSPI-4-99	Standard for Above-ground/On-ground Residential Swimming Pools	R326.3.2
ANSI/NSPI-5-03	Standard for Residential In-ground Swimming Pools	R326.3.1
ANSI/NSPI-6-99	Standard for Residential Portable Spas	R326.4.2
<b>UL</b>	<b>Underwriters Laboratories, Inc.</b>	

## Swimming Pool Electrical Plan

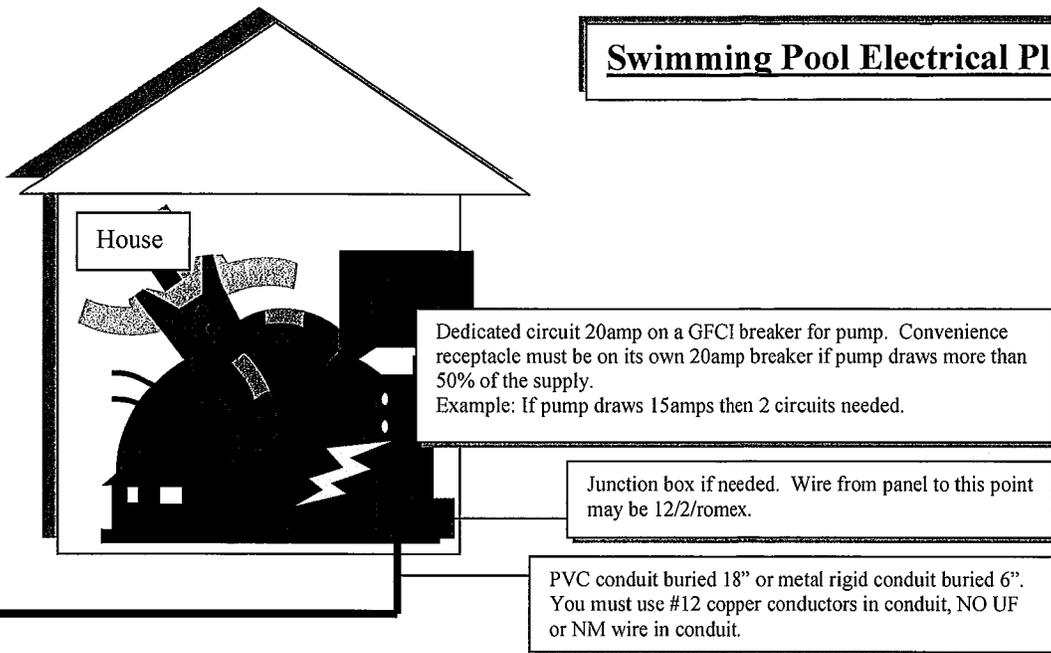


See the 2017 IRC Uniform Code Supplement, Section 326 for swimming pool enclosure requirements.

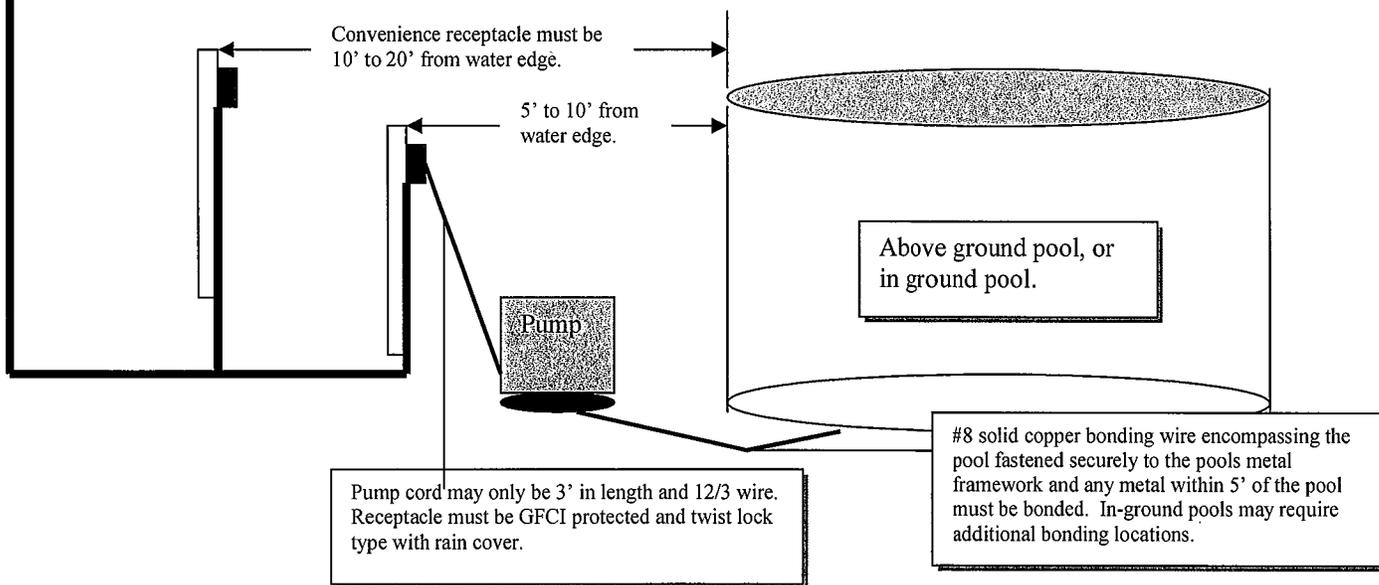

### Please note:

This handout is to help you with a tentative plan and layout in accordance with the 2014 edition of the NEC and the 2015 IRC Chapter 42. Our Department uses third party inspection agency for all electrical inspections. Prior to any installation it is recommended that you contact an inspection agency with any questions you may have. Not all pools or locations are the same, so you may have some deviations from what is reflected in this handout.

# Pool Enclosure Requirements

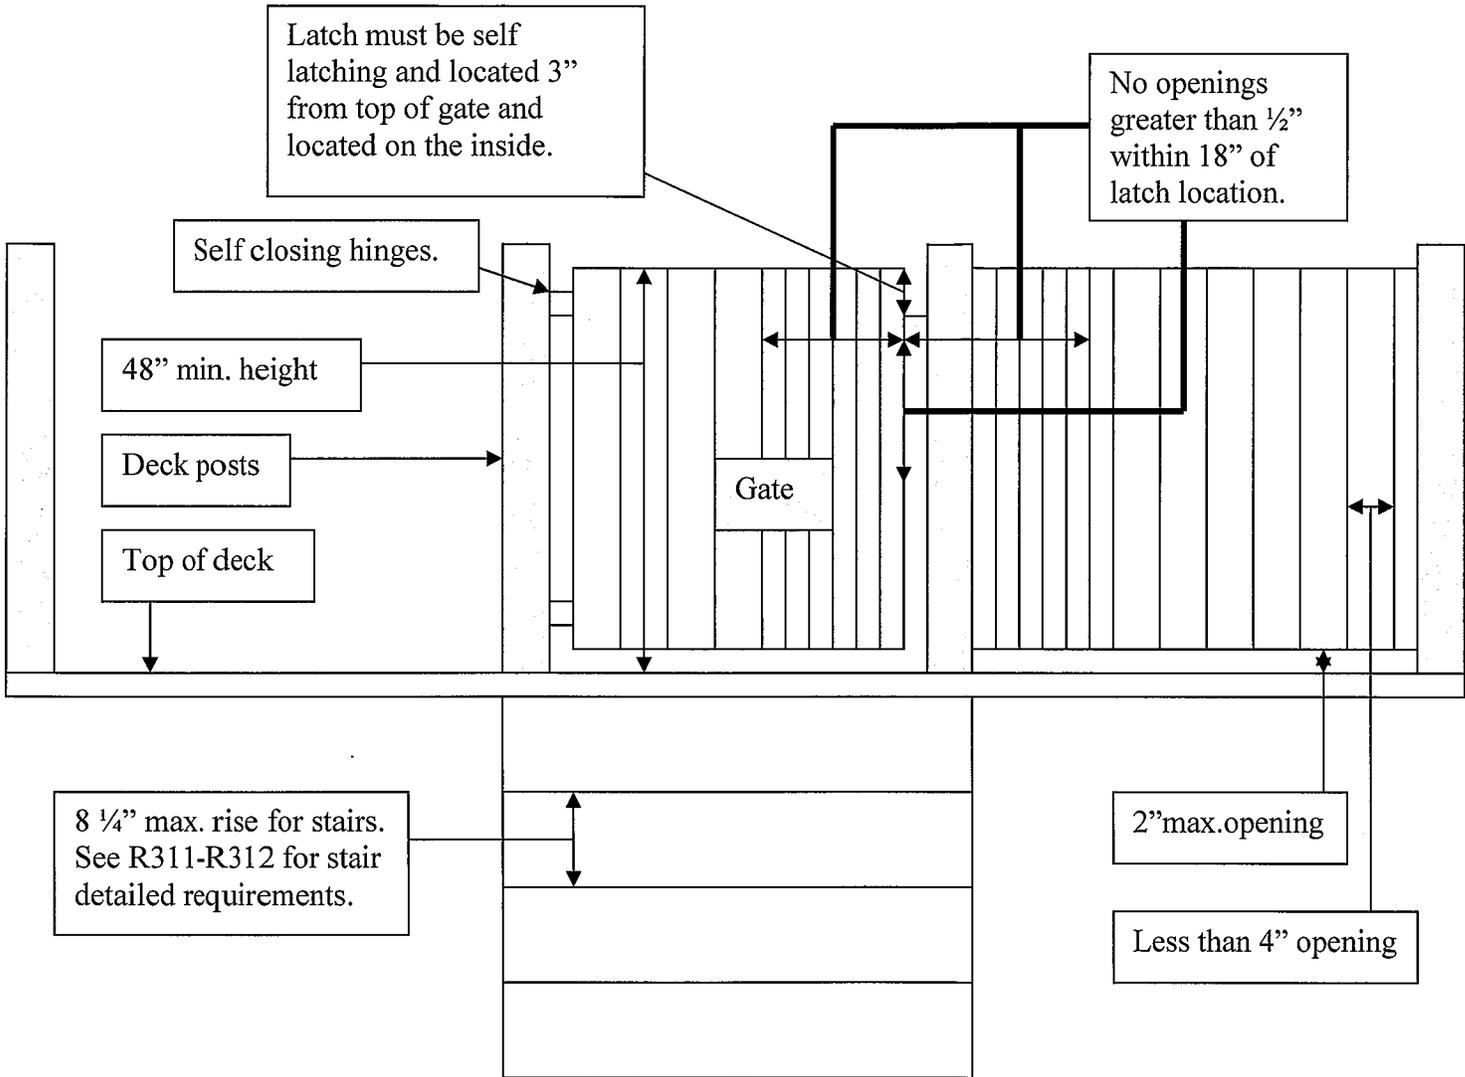

**Note:**  
Drawing is not to scale. This diagram is only showing specific location for compliance as set forth by the 2017 IRC Uniform Code Supplement, Section 326.